

PRODUCT **T24650 Series Storefront**
 2" x 6-1/2" (single thermal barrier)

TEST RESULTS

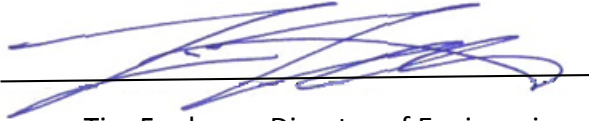
Thermal Transmittance (BTU/hr-ft ² -°F)	U-FACTOR	0.40
Condensation Resistance Factor Frame	CRF_F	63
Condensation Resistance Factor Glass	CRF_G	69
Unit Size : 78-3/4" x 78-34" [®] (glazed wall configuration)		
Glass makeup: 1" IGU 1/4" PPG Solarban 70XL #2 (e=0.018) 1/2" 90% argon, Super Spacer Premium 1/4" clear		
head, sill, jambs & vertical: single pour – debridge vertical filler: pour - debridge		

TEST LAB

INTERTEK – ATI
 York, PA 17406

Report Number	G2023.01-116-46
Test Date	10/06/16
Report Date	10/17/16

Reference ATI report #G2023.01-116-46, dated 10/17/16, for complete test specimen description and data.

Tubelite Representative:  (sign) 10/26/2016 (date)
 Tim Fookes - Director of Engineering (title)

TEST METHODS

Thermal Performance: AAMA 1503-09, Voluntary Test Method for Thermal Transmission and Condensation Resistance of Windows, Doors, and Glazed Wall Sections.