

PRODUCT **14000 Series Storefront**
 2" x 4-1/2" (non-thermal and pour-debridged thermal barrier)

TEST RESULTS

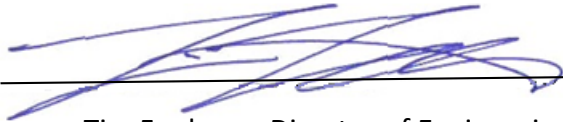
Sound Transmission Class	STC	32
Outdoor – Indoor Transmission Class	OITC	26
Unit Size : 80" x 80" (glazed wall configuration)		
Glass makeup: 1" IGU 1/4" clear 1/2" air aluminum spacer 1/4" clear		

TEST LAB

INTERTEK – ATI
 York, PA 17406

Report Number	01-34151.01
Test Date	03/24/99
Report Date	04/21/99

Reference ATI report #01-34151.01, dated 04/21/1999, for complete test specimen description and data.

Tubelite Representative:  (sign) 8/12/2016 (date)
 Tim Fookes - Director of Engineering (title)

TEST METHODS

ASTM E90-97: Standard Test Method for Laboratory Measurement of Airborne Sound Transmission Loss of Building Partitions

ASTM E413-87: Standard Classification for Rating Sound Insulation

ASTM E1332-90: Standard Classification for Rating Outdoor-Indoor Transmission Class